



Williamson County Department Of  
**SEWAGE DISPOSAL MANAGEMENT**  
1320 West Main Street - Suite 411  
Franklin, Tennessee 37064  
Voice: 615.790.5761 FAX: 615.595.1293

*- Owner -*  
**PERMIT FOR CONSTRUCTION  
OF SUBSURFACE SEWAGE  
DISPOSAL SYSTEM**

(Permit void three (3) years after date of issue)

Issued to: SAUDNERS MIKE

ID no: 18476

Gis\_no:

Location:

Subdivision:

Street Address: LEIPERS CREEK RD 5921

Installation:

New

Repair

Capacities:

Septic tank:

1500

Pump tank:

Establishment:  Residential  Other

BDR: 4 OST: 79

GPD:

Soil Evaluation Basis: SOIL TYPING BY SOILS SCIENTIST - SOIL SURVEY

Estimated absorption rate:

75


MPI

Type of System: CONVENTIONAL

Other description:

Notes:

720 FEET OF FIELD LINE IS TO BE INSTALLED IN AREA AS SHOWN ON SKETCH. WELL IS TO BE 50 FEET AND/OR WATER LINE IS TO BE 10 FEET FROM ANY PART OF SEPTIC FIELD OR SEPTIC AREA. THE SEPTIC AREA IS LOCATED ON TRACT TWO BOOK 1895 PAGE 772. AN ALTERNATING VALVE IS REQUIRED. ALL RUNOFF FROM HOUSE IS TO BE DIVERTED AROUND SEPTIC FIELD. FIELD LINES ARE TO REMAIN 20 FEET FROM ANY PROPERTY LINES. THE INSTALLER MUST CONTACT THIS DEPARTMENT FOR AN ON-SITE SYSTEM LAYOUT PRIOR TO STARTING ANY WORK.

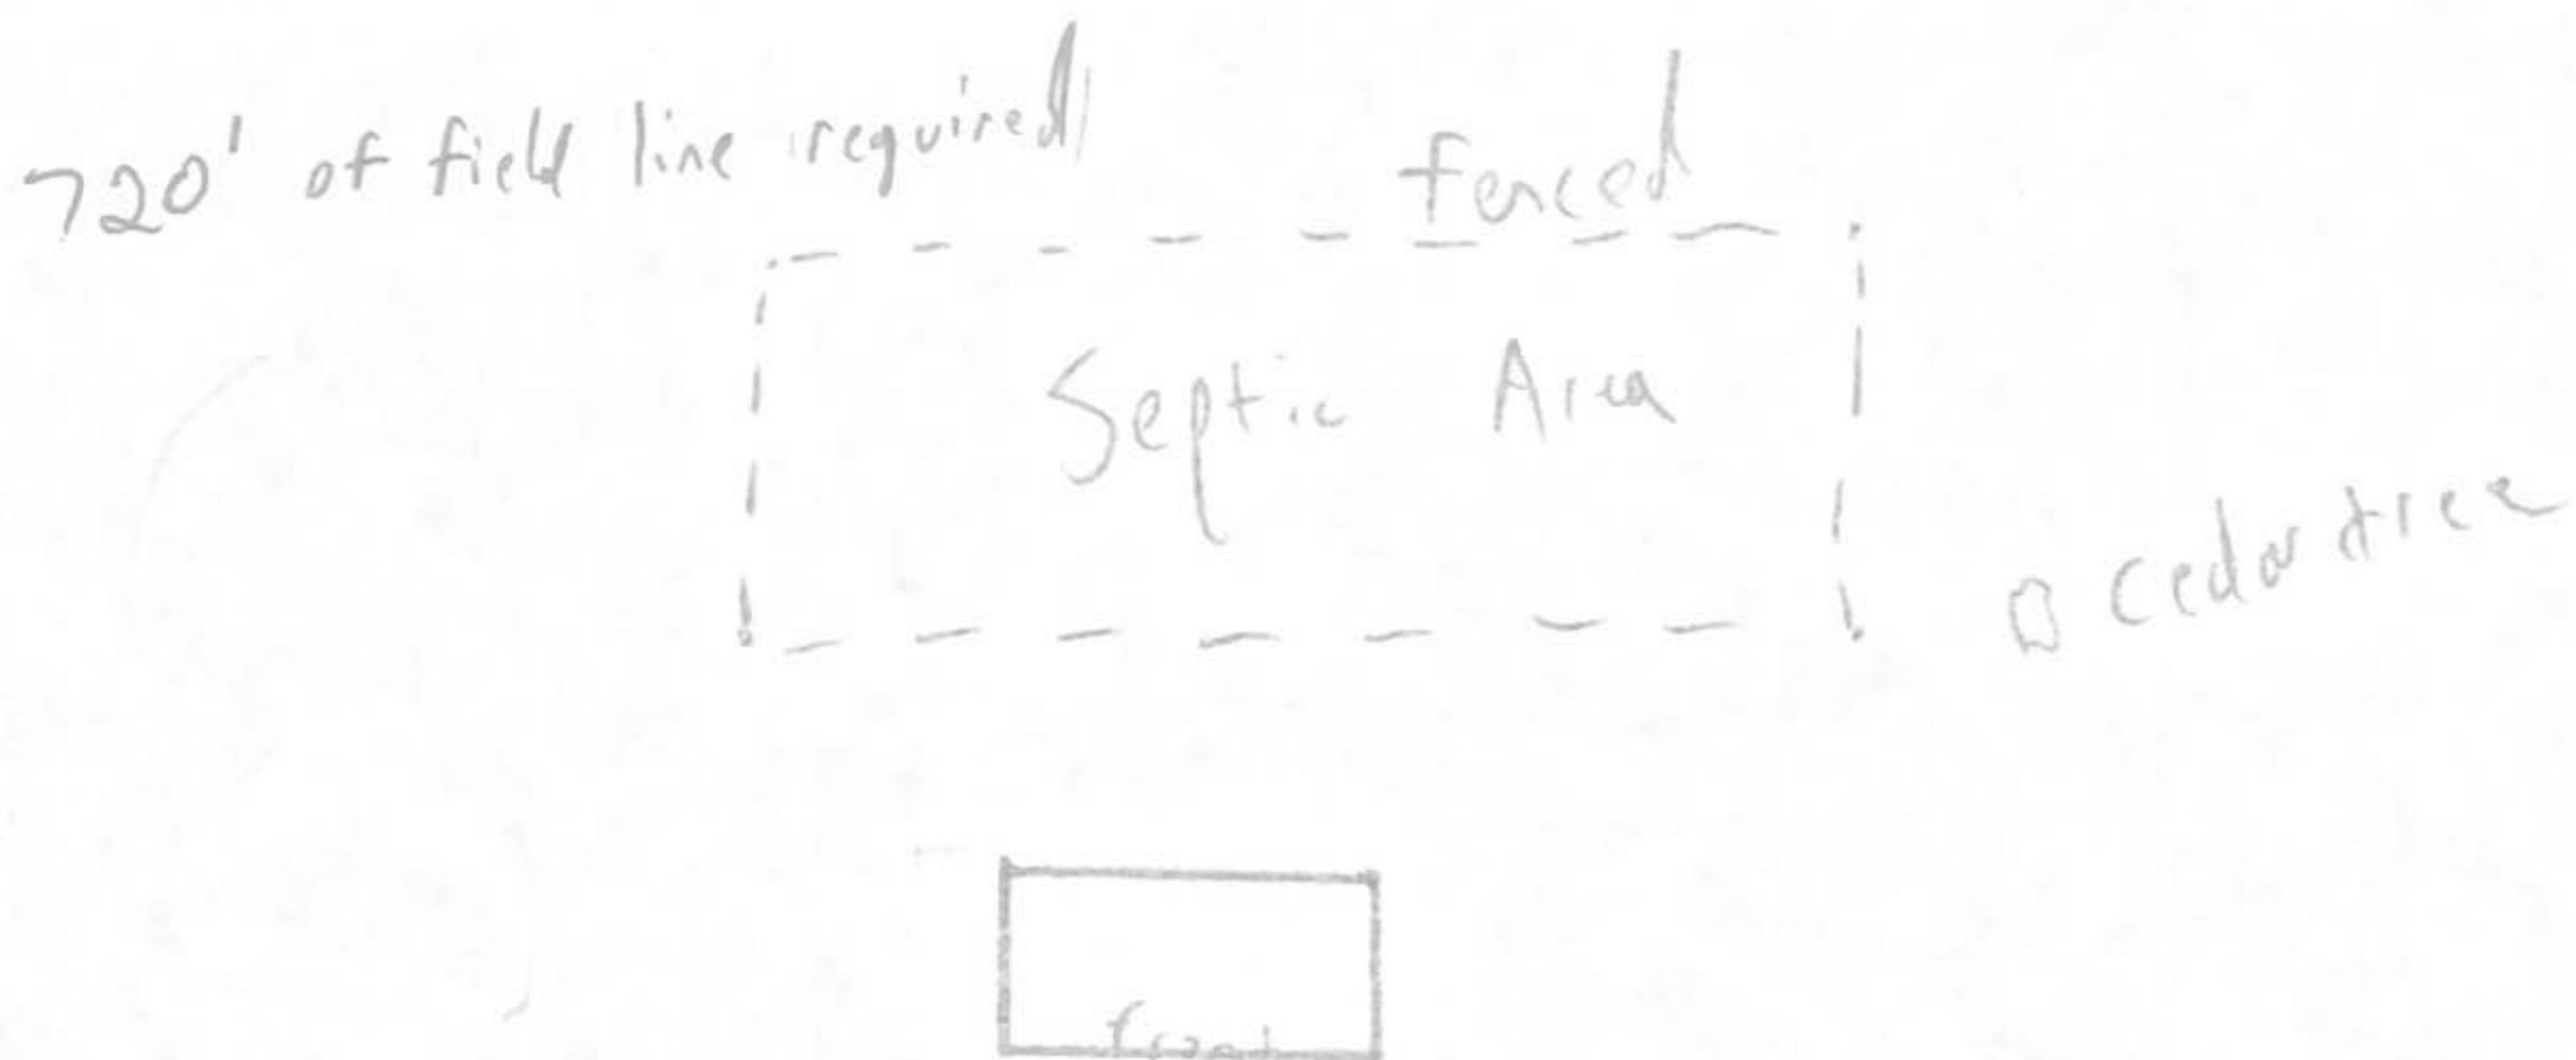

The recipient of this permit agrees to construct or have constructed the system described above in accordance with the Regulations to Govern On-Site Sewage Disposal Systems of the Williamson County Department of Sewage Disposal Management, as operated under the auspices of the Williamson County Board of Health, and T.C.A. 68-221-401 et. seq. All installers of subsurface sewage disposal systems must hold a valid annual license from the Williamson County Department of Sewage Disposal Management.

Signature

*Mike Sanders*  
(Signature of Recipient)

Date

*8/27/02*

Issued by

ELLIOT ELEY

*EE*

(Name)

SOILS SCIENTIST

(Title)

8/27/02

(Date)